





LAG-91423K



TEMP.& WATER PRESSURE REQUIREMENTS

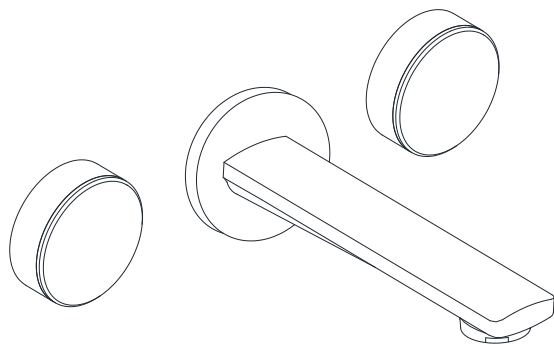


Working Pressure: 1~3 bar




Required Temperature: 5-65°C


Note: Above values are the recommended values for Getting Conventional Outputs.


TECHNICAL DRAWING

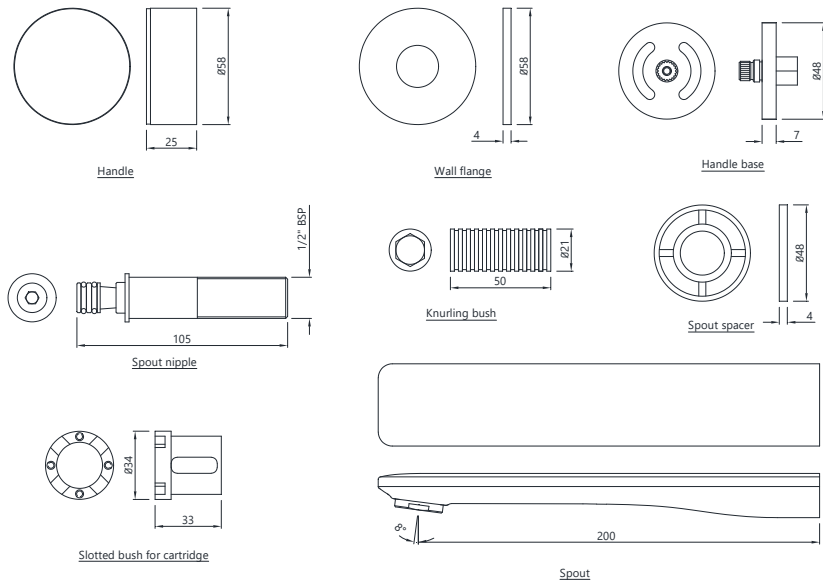


TAKE CARE DURING CONNECTION'S


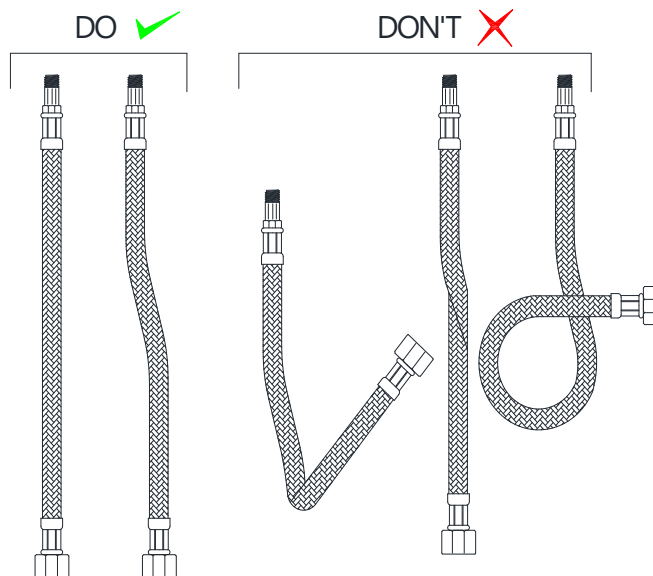


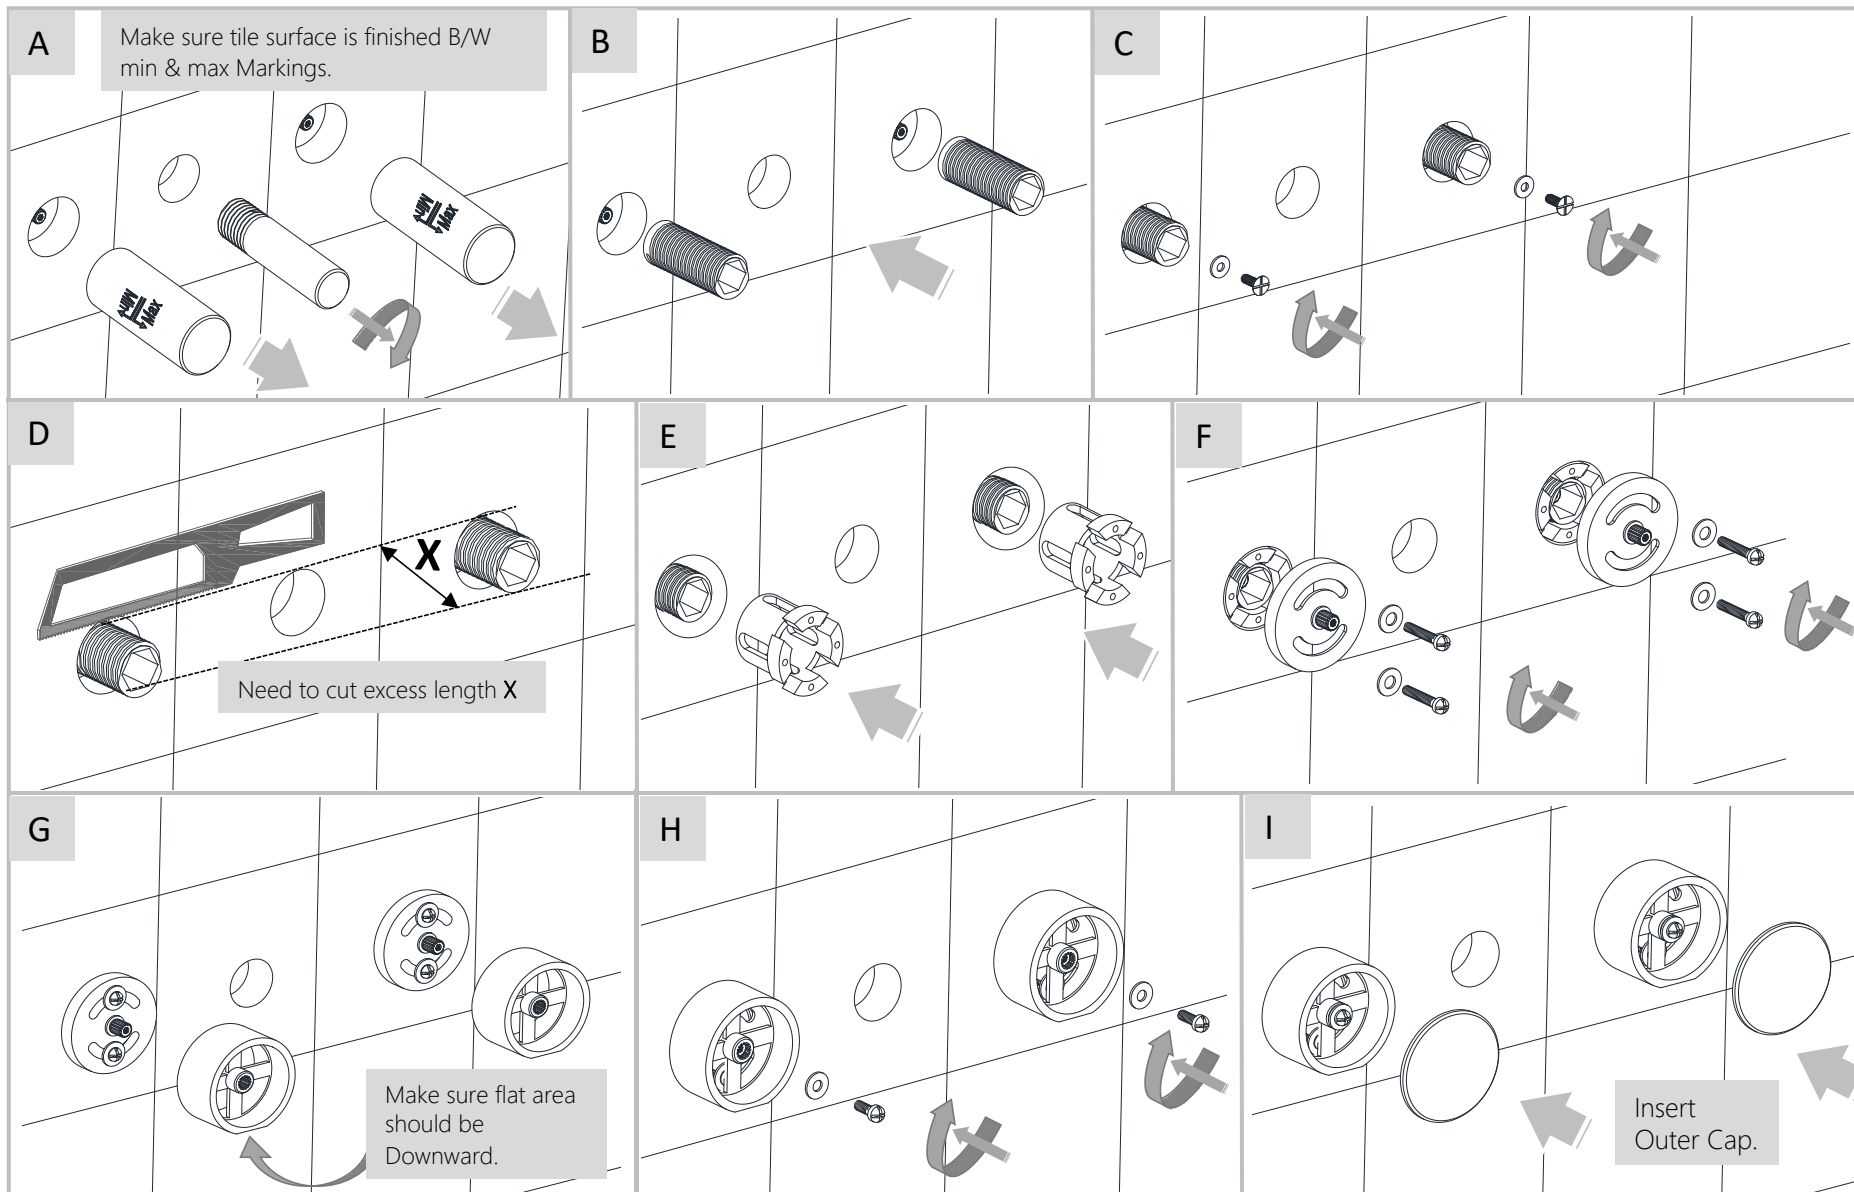



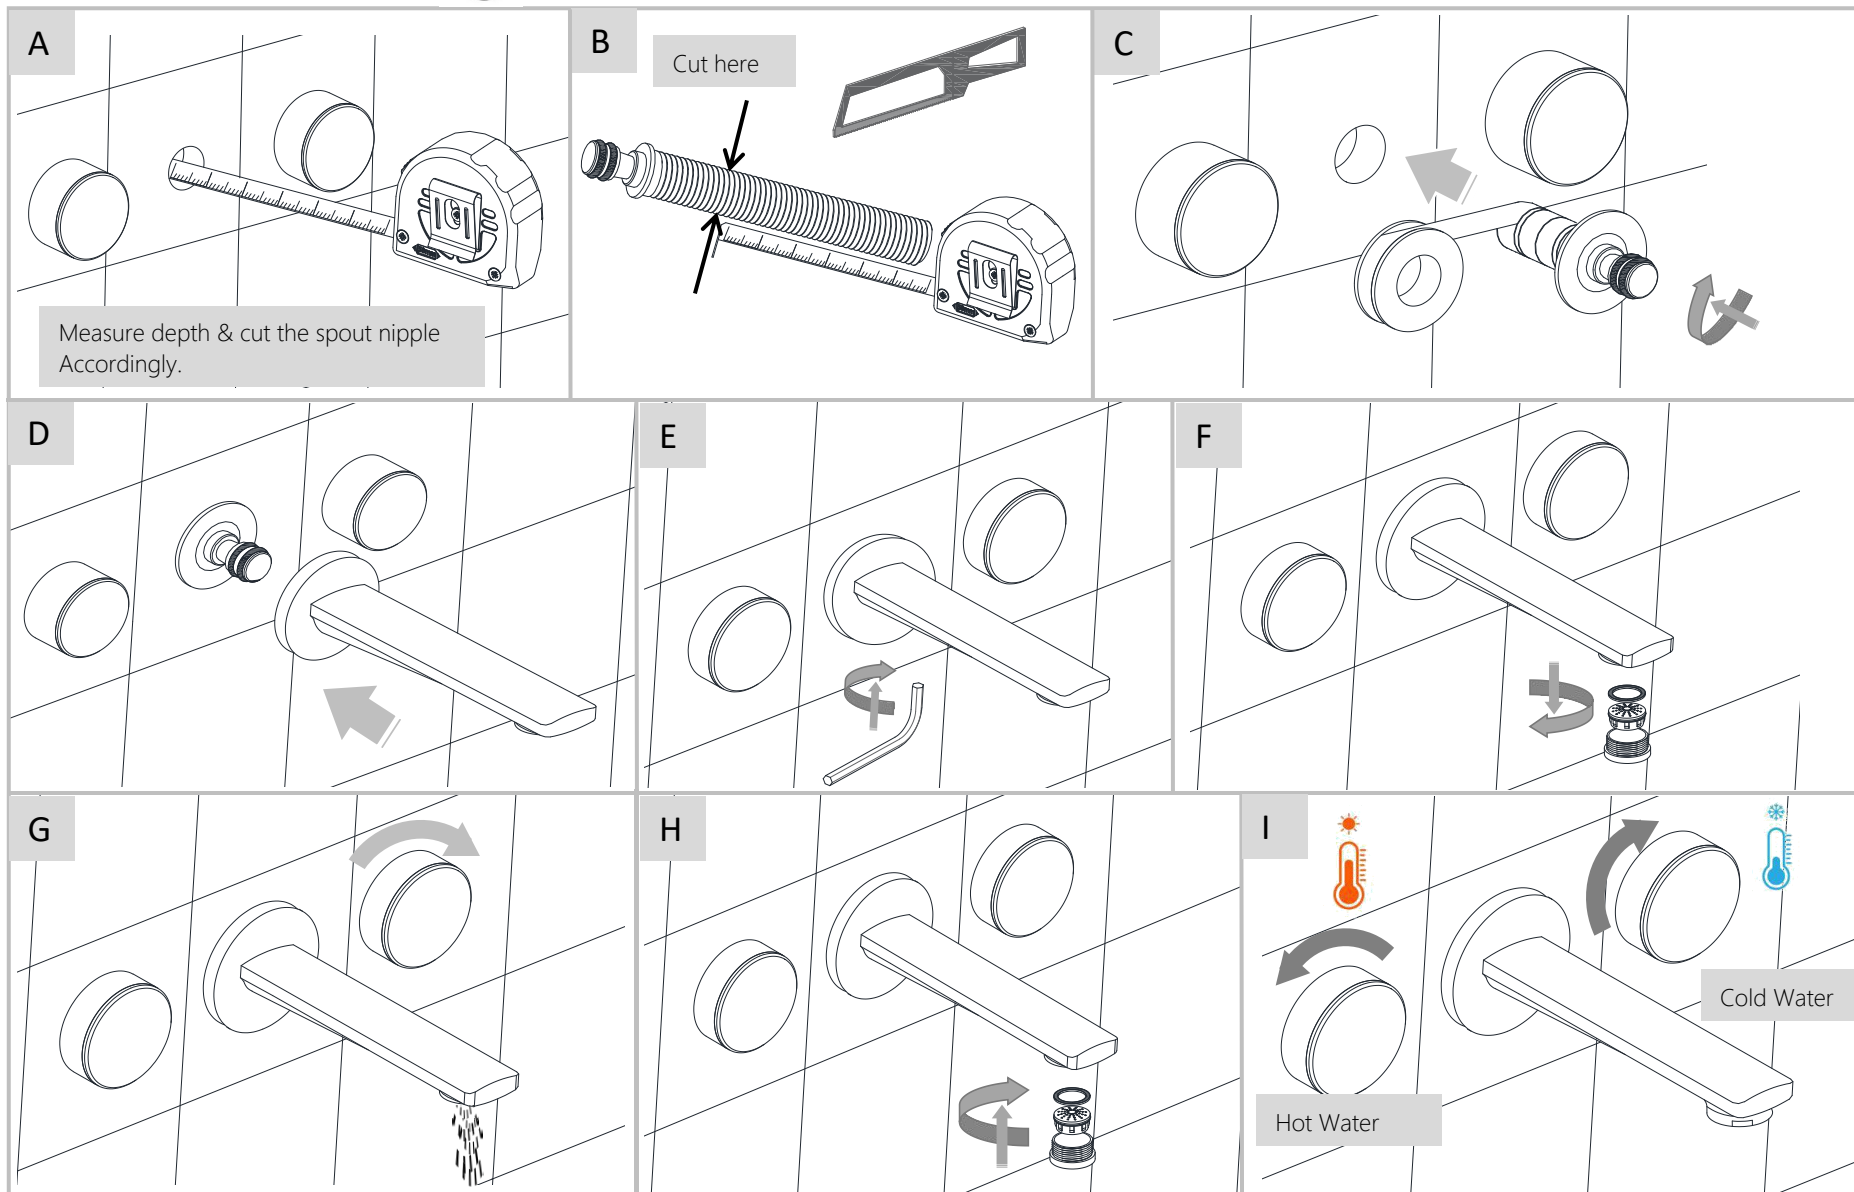


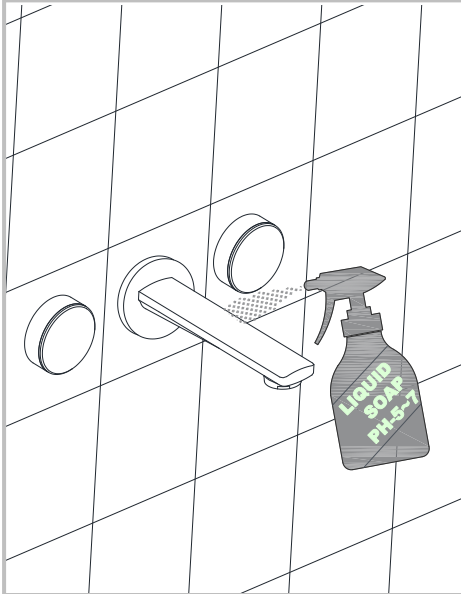

Apply soft cotton cloth

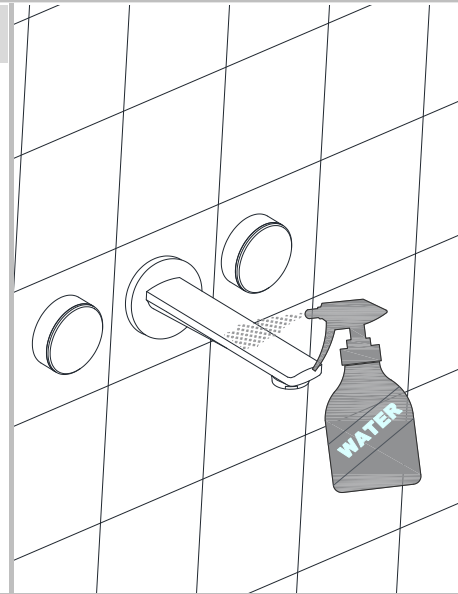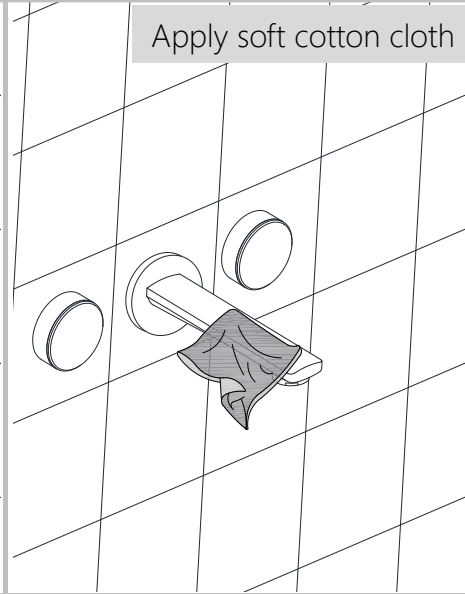

Apply soft cotton cloth

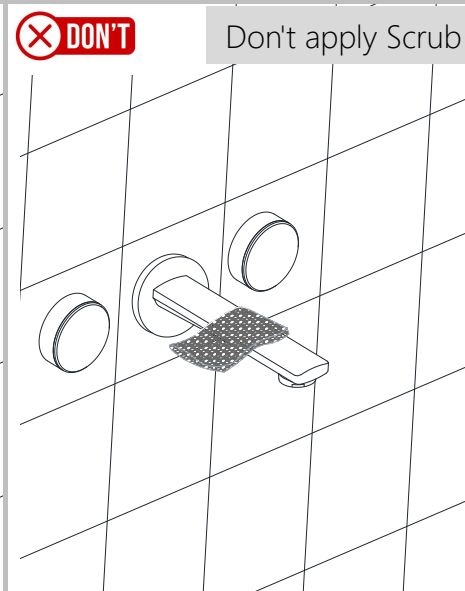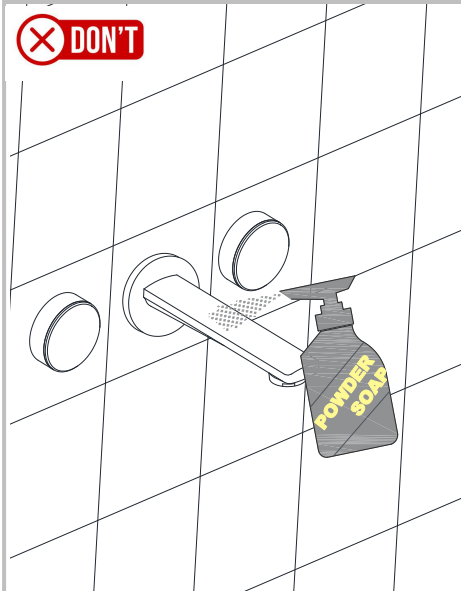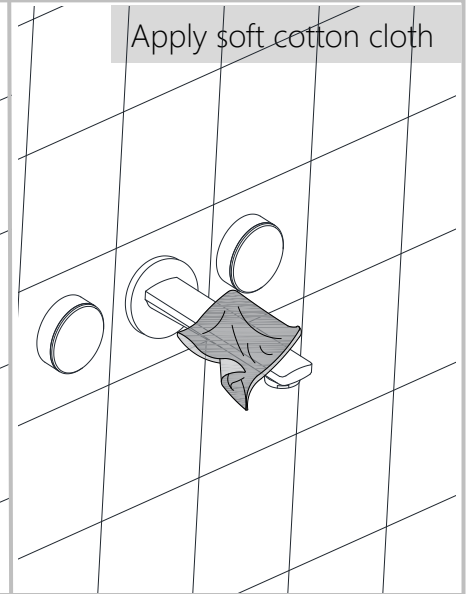

Don't apply Scrub

Steps & Cleaning agents requirements for Aerator Cleaning.

