


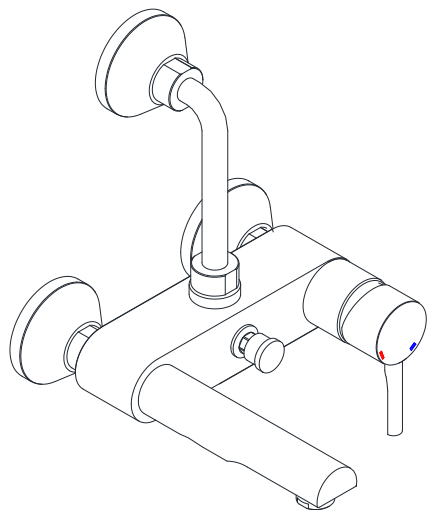


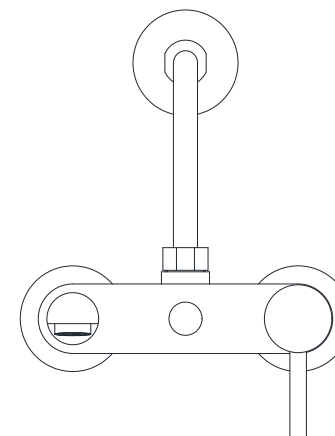

## FLP-5117PM

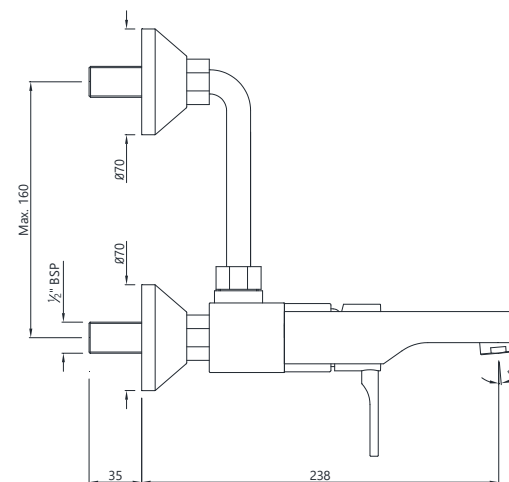

## TECHNICAL DRAWING

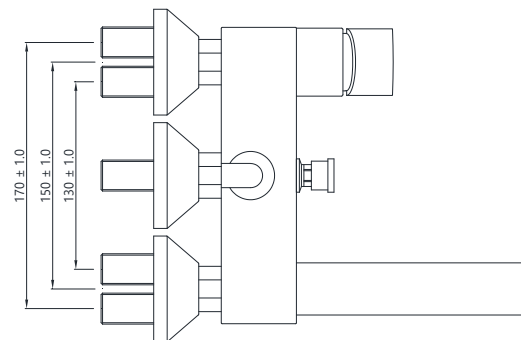

## TEMP. &amp; WATER PRESSURE REQUIREMENTS





Working Pressure: 1~3 bar









Required Temperature: 5-65°C

Note: Above are the recommended values for getting Conventional Output.

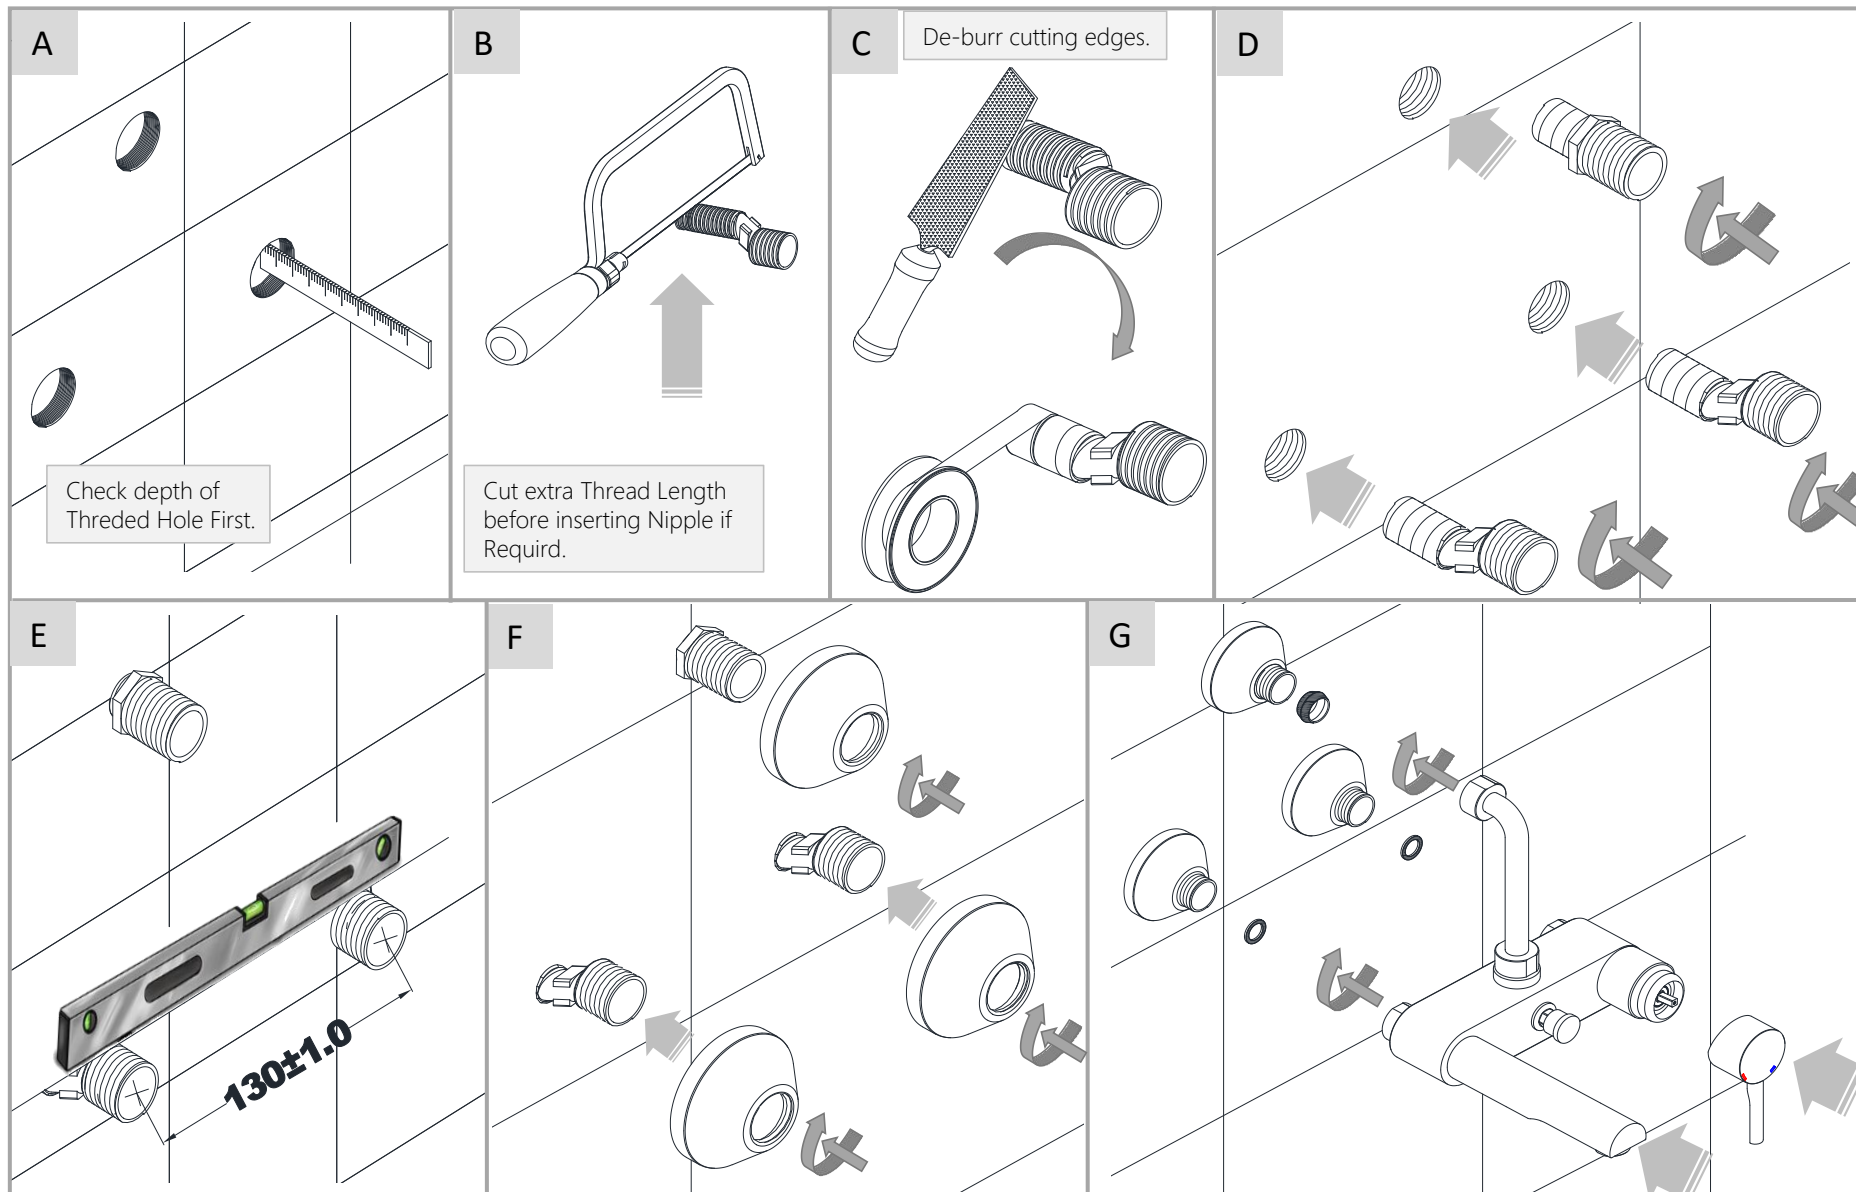

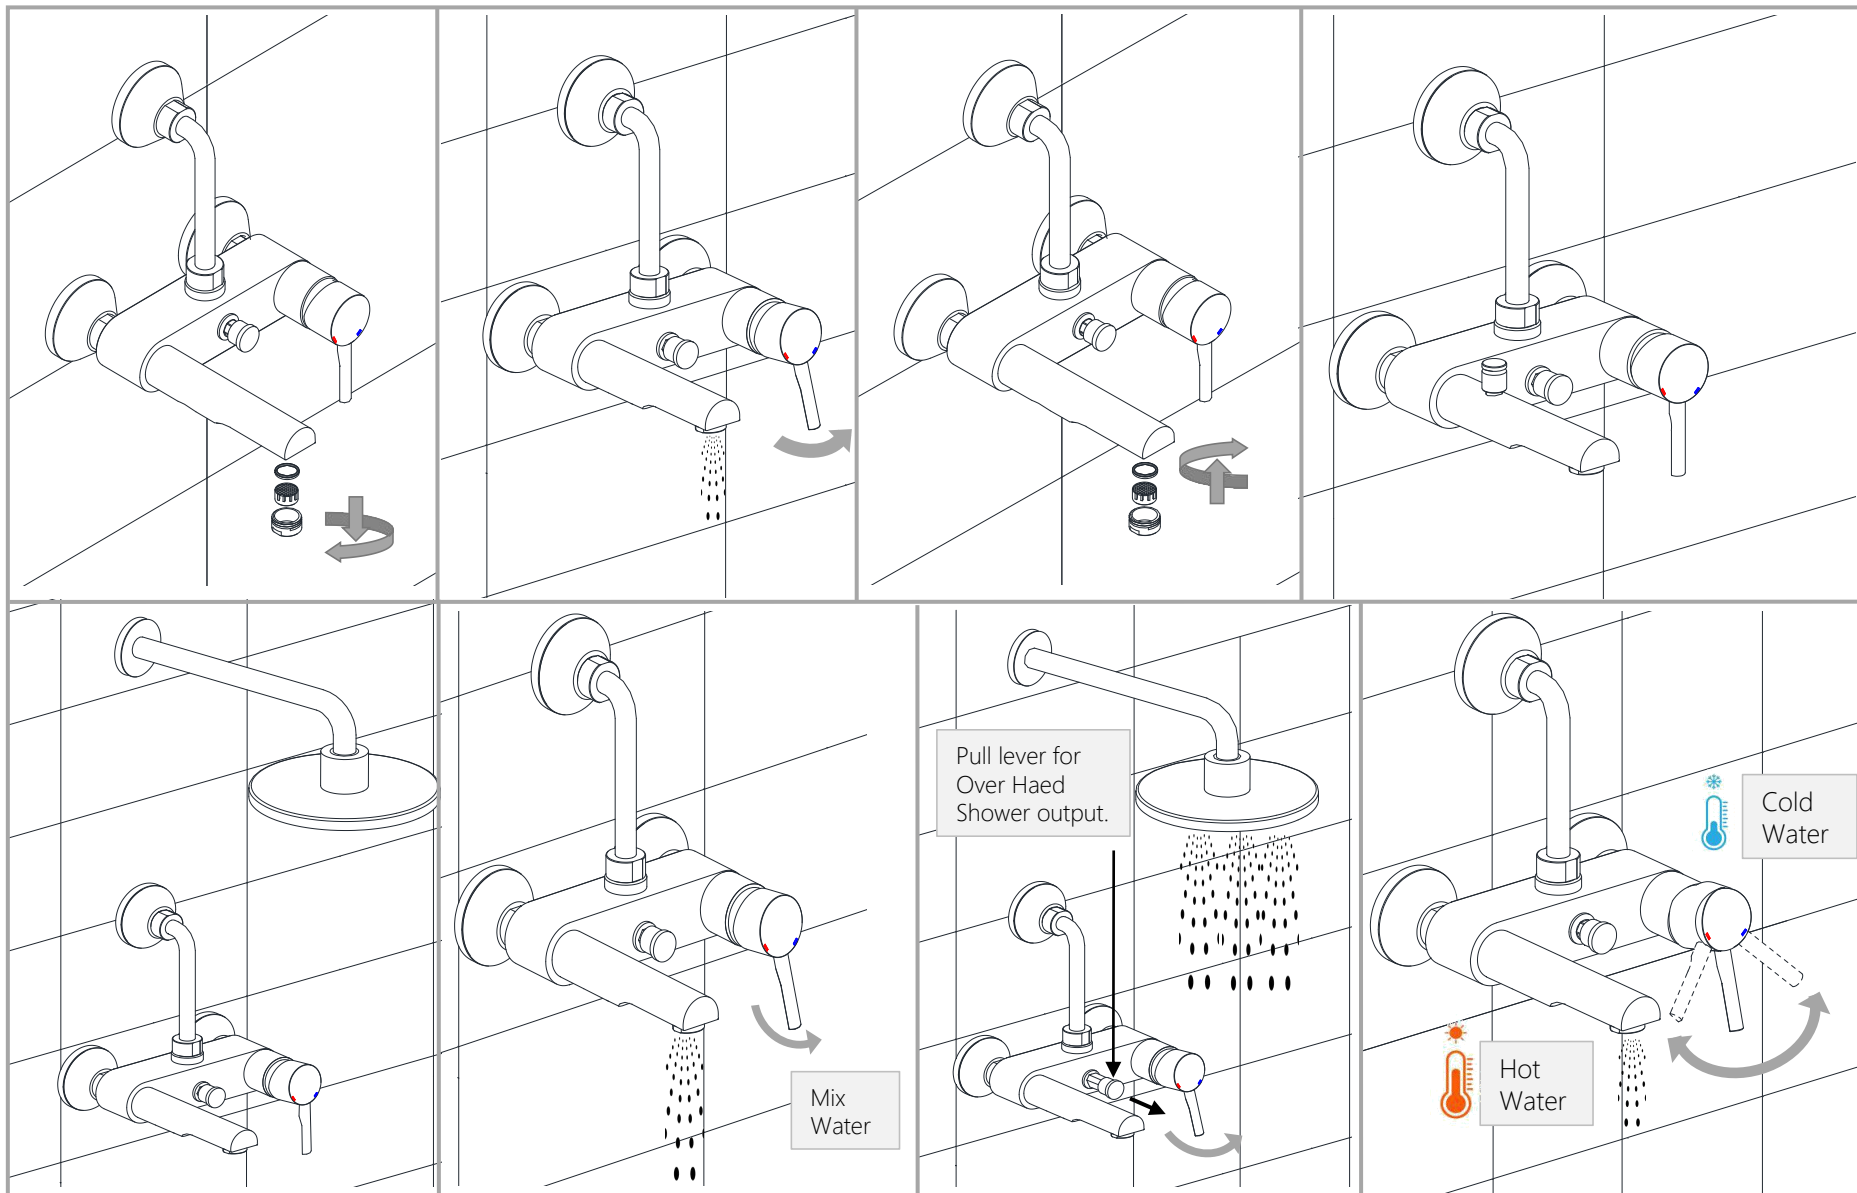

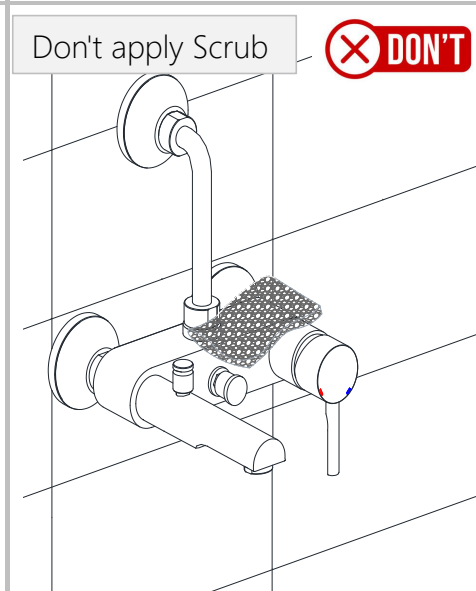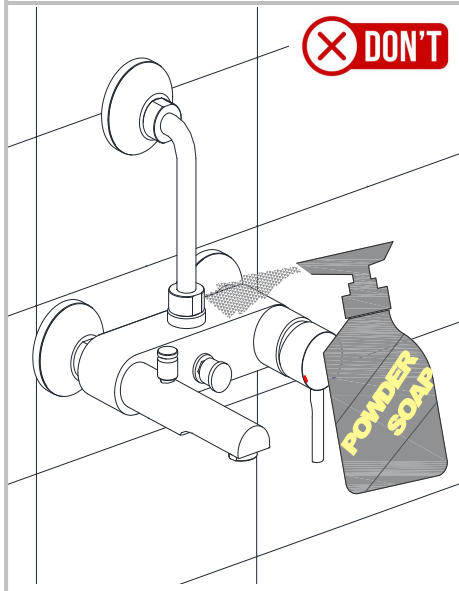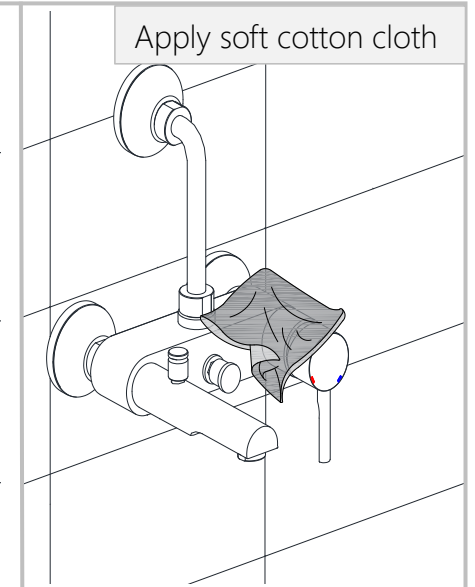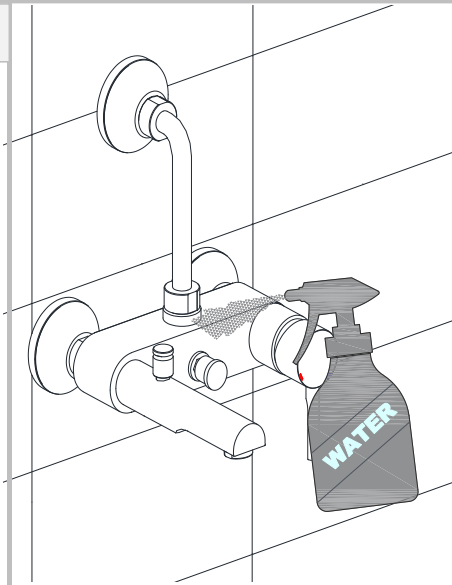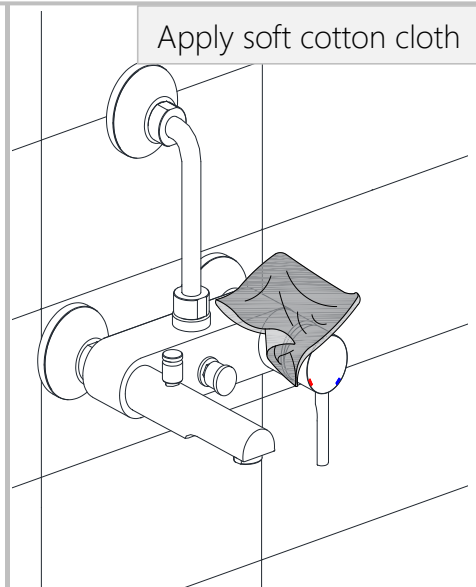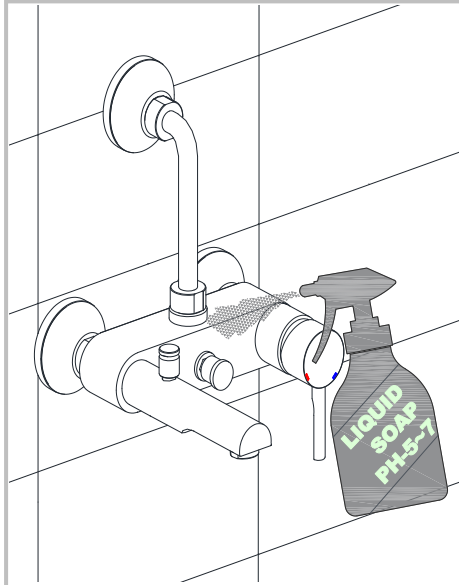

Steps & Cleaning agents requirements for Aerator Cleaning.

